
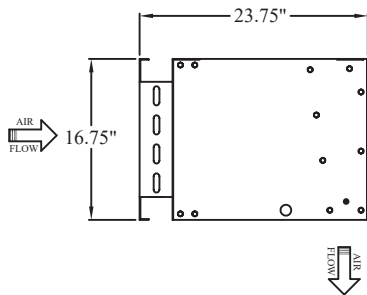


**NOTE: Control valves and valve controls are supplied by others**

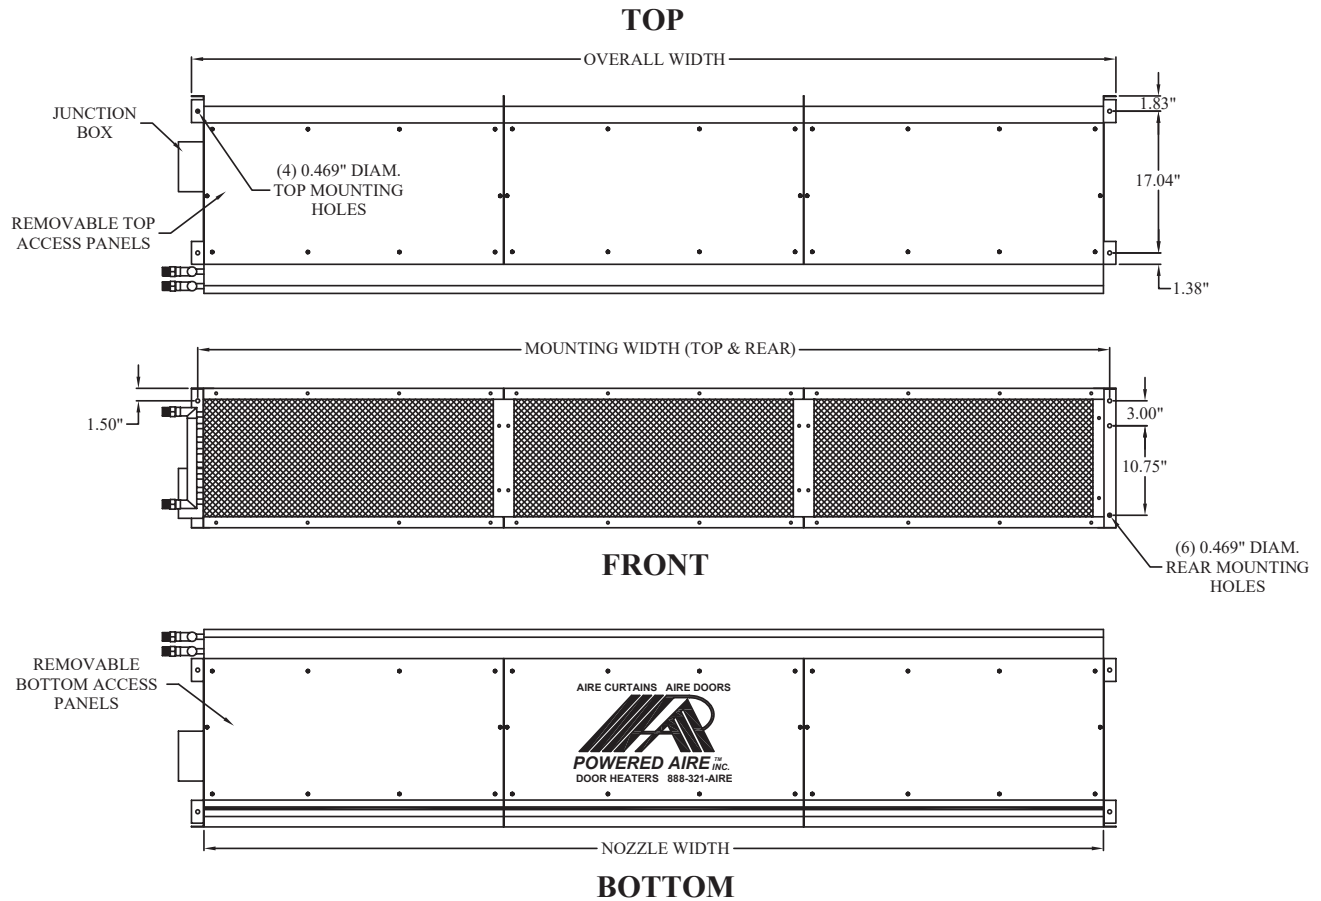

**NOTES:**

1. Installer is responsible for structurally sound mounting of the unit.
2. Verify that overall dimensions will fit in opening.
3. Coil connections shown on left hand side. Can be either right or left. Please specify.
4. If filters are required add 2 1/8" to air curtain depth (23.75" dimension)
5. Size stream trap (provided by others) by 3 times the manufacturer's recommended size for satisfactory operation.

MODEL NUMBER	CHS-1-36 HW/ST	CHS-1-48 HW/ST	CHS-1-60 HW/ST	CHS-2-72 HW/ST	CHS-2-84 HW/ST	CHS-2-96 HW/ST	CHS-2-108 HW/ST	CHS-3-108 HW/ST	CHS-3-120 HW/ST	CHS-3-132 HW/ST	CHS-4-144 HW/ST
OVERALL WIDTH	39.00	51.00	63.00	75.07	87.07	99.07	111.07	111.15	123.15	135.15	147.22
NOZZLE WIDTH	36.00	48.00	60.00	72.07	84.07	96.07	108.07	108.15	120.15	132.15	144.22
MOUNTING WIDTH	37.50	49.50	61.50	73.57	85.57	97.57	109.57	109.65	121.65	133.65	145.72