

► EHD-IG | MECHANICAL DETAILS & DRAWINGS (2 HEATER)


EHD-IG | 2-Heater Mechanical Information Table

| MODEL | Air Curtain Width - A (in.) | Mounting Width - B (in.) | Hanging Width - C (in.) | Flue Diameter - D (in.) | Heater Size | Gas Inlet (in.) |
|-------------|-----------------------------|--------------------------|-------------------------|-------------------------|-------------|-----------------|
| EHD-2-120IG | 123.13 | 119.13 | 30.63 | 5 | 2 × 250 | 0.75 |
| EHD-2-132IG | 135.13 | 131.13 | 30.63 | 5 | 2 × 250 | 0.75 |
| EHD-2-144IG | 147.13 | 143.13 | 30.63 | 5 | 2 × 250 | 0.75 |
| EHD-3-156IG | 159.25 | 155.25 | 48.63 | 6 | 2 × 350 | 0.75 |
| EHD-3-168IG | 171.25 | 167.25 | 48.63 | 6 | 2 × 400 | 0.75 |
| EHD-3-180IG | 183.25 | 179.25 | 48.63 | 6 | 2 × 400 | 0.75 |
| EHD-3-192IG | 195.25 | 191.25 | 48.63 | 6 | 2 × 400 | 0.75 |
| EHD-3-204IG | 207.25 | 203.25 | 48.63 | 6 | 2 × 400 | 0.75 |
| EHD-3-216IG | 219.25 | 215.25 | 48.63 | 6 | 2 × 400 | 0.75 |




NOTES

1. Verify that overall dimensions will fit in the opening.
2. Adequacy of support structure to be verified by a professional structural engineer.
3. Air curtain to be installed so that the air stream is unobstructed.

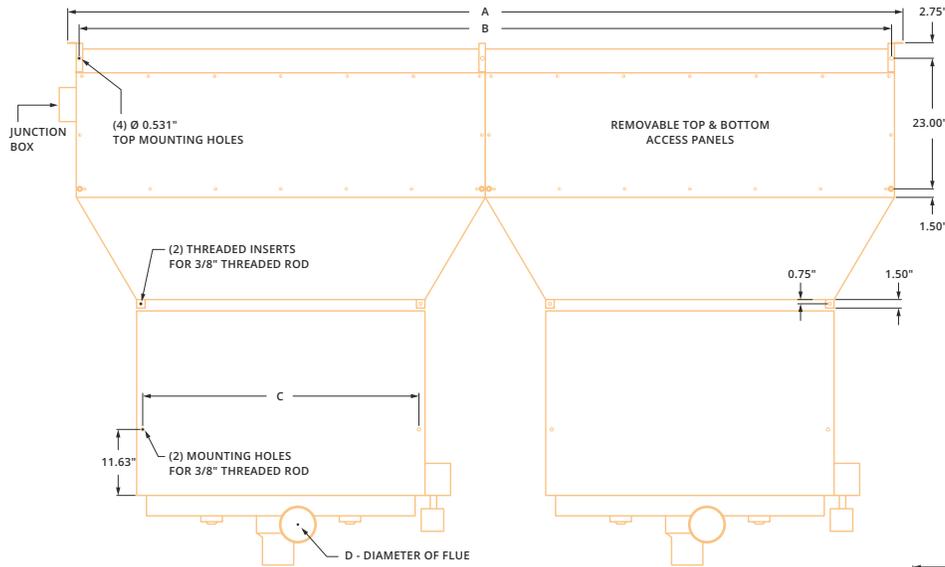

TOP

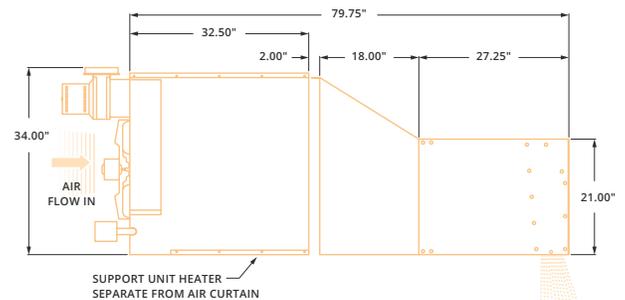

SIDE

FRONT

